


NOTES:

1. ALL PIPING SHALL BE AS NOTED.
GLUE JOINT PIPING SHALL NOT BE USED.

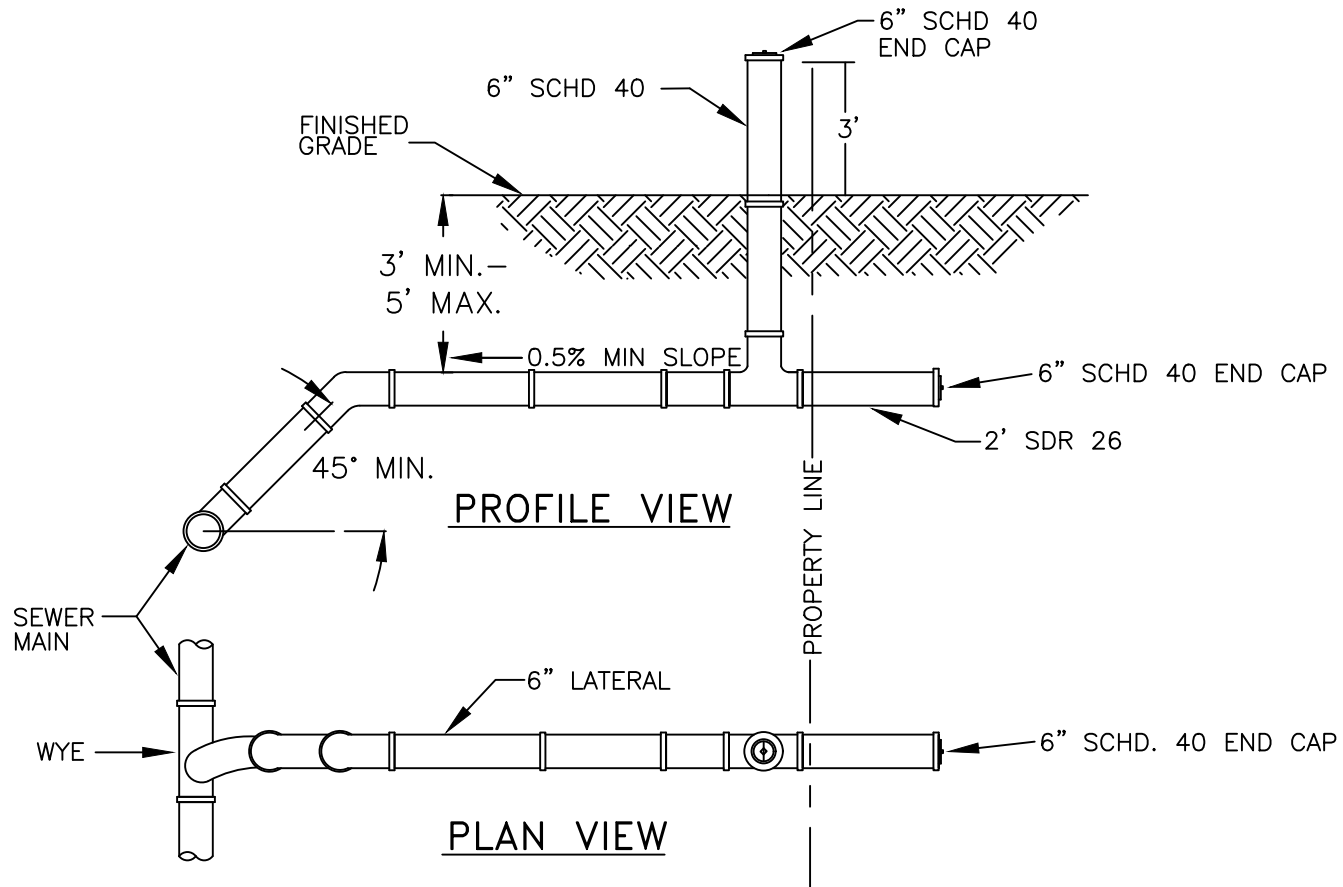

DORCHESTER COUNTY WATER & SEWER	
6 INCH SEWER SERVICE	DRAWING: S-25
DATE: <u>NOVEMBER 2020</u>	DRAWN BY: <u>STL</u>
SCALE: <u>NTS</u>	APPROVED BY: <u>JDC</u>